
#### Ordering information

NAM series

NAM -10 -000



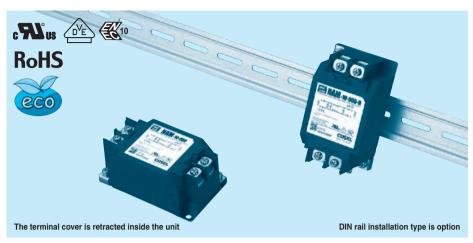

- ①Model Name ②Rated Current ③Line to ground capacitor code:See table 1.1.

table1.1 Line to ground capacitor code

Code	Leakage Current (Input 125/250V 60Hz)	Line to ground capacitor (nominal value)		
000	5 μ A/ 10 μ A max	Not Provided		
101	12.5 μ A/ 25 μ A max	100pF		
221	25 μ A/ 50 μ A max	220pF		
331	37.5 μ A/ 75 μ A max	330pF		
471	50 μ A/100 μ A max	470pF		

- When the line to ground capacitor code is different, the attenuation characteristic is different.
- ④Options D:DIN rail installation type
  - $\boldsymbol{\ast}$  The dimensions change when the option is set. Refer to External view.

### **Features of NAM series**


## Low leakage current type

- · Single Phase 250 VAC
- · Push down type terminal block


## **Specifications**

No.	Items	NAM-04-000	NAM-06-000	NAM-10-000	NAM-16-000	NAM-20-000	NAM-30-000	
1	Rated Voltage[V]	AC 1 φ 250 / DC250						
2	Rated Current[A]	4	6	10	16	20	30	
3	Test Voltage (Terminal-Mounting Plate) 2,500 VAC (Cutoff Current = 20mA), 1 minute at room temperature and humidity							
4	Isolation Resistance (Terminal-Mounting Plate)	500 VDC 100M $\Omega$ min at room temperature and humidity						
5	Leakage current 125/250V 60Hz	5μA/10μA max						
6	Voltage drop 1.0V max							
7	Safety agency approval temperatures	-25 to +85℃ (Refer to Derating Curve)						
8	Operating temperature	-40 to +85℃ (Refer to Derating Curve)						
9	Operating humidity	20 to 95%RH (Non condensing)						
10	Storage temperature/humidity	-40 to +85℃/20 to 95%RH (Non condensing)						
11	Vibration	10 to 55Hz, 19.6m/s² (2G), 3min. Period, 1hour each X, Y and Z axis						
12	Impact	196.1m/s² (20G), 11ms Once each X, Y and Z axis						
13	Safety agency approvals	UL1283, CSA C22.2 No.8 (C-UL), DIN EN60939 VDE0565 Teil3-1, ENEC (At only AC input)						
14	Case size (without projection) /Weight	53 X 41 X 92 mm [2.09 X 1.61 X 3.62 inches] (W X H X D) /300g max (Option : -D refer to external view)						

## **Circuit Diagram**

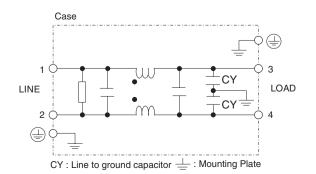

#### **Derating Curve**

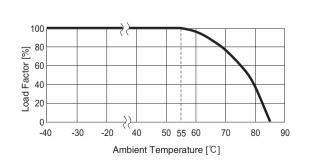


# NAH,NAC,NAM,NAP series


#### **External view**

As this product is adopted push-down type terminal block, this appearance is as follows.

- 1)The terminal cover is retracted inside the unit.
- 2)The screws for connecting the terminals are held in the up right position.

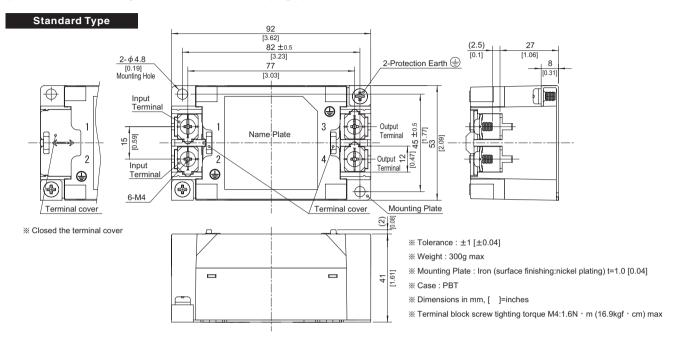

#### **DIN rail installation Type**

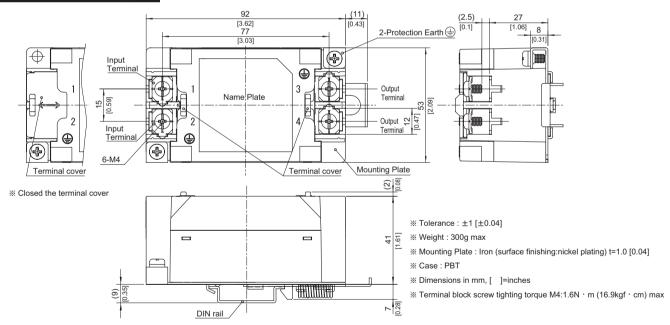

## ■Note when installing the EMI/EMC Filter on a DIN rail.

When the EMI/EMC Filter is grounded through the DIN rail, the proper noise attenuation may not be achieved.

Be sure to connect the protection earth (PE) of the EMI/EMC Filter body to the earth.

It can connect the ground to either one only.

